



**Installation, Operation,
and Service Manual**

**Innovator Door
System**

for Walk-in Coolers

M001172 Rev A
May 2025

Models Covered
30" x 75", 30" x 67", 30" x 82"

Certifications



STYLELINE Doors are compliant with United States DOE 2017 requirements.

Installation and service must be performed by a qualified installer or service agency.

READ THE ENTIRE MANUAL BEFORE INSTALLING THIS EQUIPMENT AND OBSERVE ALL CAUTIONS AND WARNINGS. WHERE AVAILABLE, KEEP MANUAL IN STORE FOR FUTURE REFERENCE.

Innovator Door System

User Safety and Product Information

Legal Disclaimer

Review all safety warnings on the case and in this manual before attempting start-up. STYLELINE shall not be liable for any repair or replacement made without the written consent of STYLELINE, or when the product is installed or operated in a manner contrary to the printed instructions covering installation and service which accompanied such product. Please note that failure to follow the instructions in this document may void your factory warranty.

ANSI Z535.5 Definitions

The definitions below are used to clarify the magnitude and urgency of harm and damage, considering problems arising from misuse. Relative to their potential danger, the definitions are divided into five parts according to ANSI Z535 Series.



DANGER indicates a hazardous situation which, if not avoided, will result in death or serious injury.



WARNING indicates a hazardous situation which, if not avoided, could result in death or serious injury.



CAUTION indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.



NOTICE is used to address practices not related to personal injury.



SAFETY INSTRUCTIONS (or equivalent) signs indicate specific safety-related instructions or procedures.

Proposition 65



This warning does not mean that STYLELINE products will cause cancer or reproductive harm, or is in violation of any product-safety standards or requirements. As clarified by the California State Government, Proposition 65 can be considered more of a 'right-to-know' law than a pure product safety law. When used as designed, STYLELINE believes that our products are not harmful. We provide the Proposition 65 warning to stay in compliance with California State law. It is your responsibility to provide accurate Proposition 65 warning labels to your customers when necessary. For more information on Proposition 65, please visit the California State Government website.

Innovator Door System

Table of Contents

User Safety and Product Information	2
Legal Disclaimer	2
ANSI Z535.5 Definitions	2
Proposition 65	2
Installation Information	4
General	4
Application	4
Parts List	4
Electrical Specifications	5
Specifications for Opening	5
Shipping Damage	5
Preparation	5
Install Frame	6
Joining Frames	9
Preparation of Mullions and Ends	10
Frame Shelf Bracket Post Profiles	11
Attach Door Handles	15
Install Doors	15
Adjust Closing Torque	16
Conditioning Gaskets	18
Restoring Gasket Seal	19
Service and Repair	20
Replacing Doors	20
Replacing Door Hinge Spring	21
Replacing Magnetic Gasket	21
Door Handle Replacement	23
LED Fixture	24
LED Fixture Replacement	24
Remove Protective Film	25
LED Power Supply Replacement	25
Frame Heater Replacement	26
Dimmer Control	27
(Optional) Dimmer	27
Dimmer Operation	28
Program Dimmer Control	29
Dimmer Control Troubleshooting	30
Wiring Diagram	31
Replacement Parts List	32
Warranty	35
Revision History	35

Innovator Door System

Installation Information

General

This document provides information necessary for successful installation and operation of the Innovator Cooler Door System. The door nameplate is attached to the top of the door, handle side, behind the magnetic gasket. The frame nameplate is located on the top left near the switch.

Application

The door system is designed for installation in new medium temperature or low temperature walk-in coolers with insulated structural walls. To maintain structural integrity of the cooler wall and the door system, the cooler wall must be manufactured with a reinforced opening to match the door frame.

Frames may be joined when more than a 5 door length is needed. Frames to be joined are manufactured without the vertical outside frame flange.



Innovator Cooler Door System



Standard Reinforced Opening

Parts List						
Item	Quantity					Description
	1 Door	2 Door	3 Door	4 Door	5 Door	
1.	1	1	1	1	1	Frame
2.	10	20	30	40	50	Screws
3.	1	1	1	1	1	Silicone
4.	1	2	3	4	5	Doors
Joining						
5.	1	1	1	1	1	Joint Molding
6.	5	5	5	5	5	Binder Post and Screw

Innovator Door System

Installation Information

Electrical Specifications

Appropriate electrical power must be available for the door system, including lighting and heaters. Check the nameplate for minimum circuit ampacity and maximum over-current protection device. Always follow NEC guidelines and local codes.

Specifications for Opening

Each door frame is 1 to 5 doors wide. Several standard frame heights are available. Always compare the wall opening dimensions with the frames to be installed.

Shipping Damage

All equipment should be thoroughly examined for shipping damage before and during unloading.

This equipment has been carefully inspected at our factory. Any claim for loss or damage must be made to the carrier. The carrier will provide any necessary inspection reports and/or claim forms.

Preparation


Clear an area outside the wall opening to lay the frame flat and work around it. Gather tools needed for installation.

Doors are shipped separately from the frame. Set doors aside until frame is installed. Lay the frame face down. Remove all packing materials, packaged parts and tape. Take care not to scratch or otherwise damage frame face.

⚠ CAUTION

Exterior Loading

- » Excessive ambient conditions may cause condensation and therefore sweating of doors. Facility operators should monitor doors and floor conditions to ensure safety of persons.

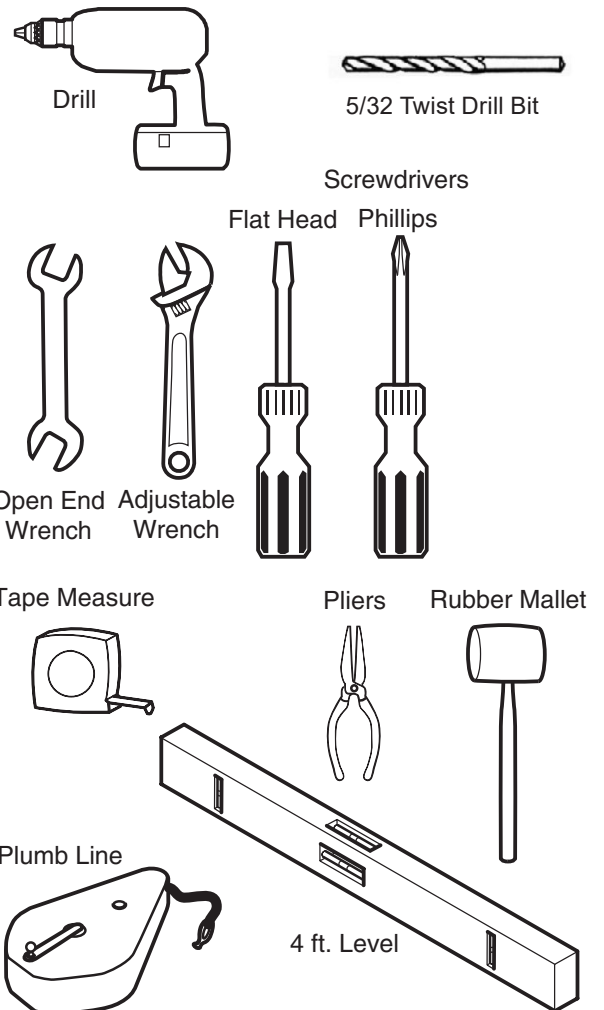

Typical Tools Needed to Install Innovator Cooler Door System



Unpack Frame and Lay Face Down

Innovator Door System

Installation Information

Install Frame

Apply Sealant

Apply field-supplied silicone sealant between edge of gasket and outside edge of frame.

Check Frame and Opening for Square

Verify the frame is not racked (out of square) by measuring from one corner diagonally to the other. The measurements must be the same. Verify that the opening is large enough for the frame. Use a long level (4 ft (1220 mm) or more) to determine if the opening is level side to side.


If shims are needed, they must be used under the frame at the bottom of the opening, or at the sides

Place Frame in Opening


Lift frame by mullions to avoid gaskets and sealant. Position bottom of frame in opening and then tilt top of frame toward opening. Take care that wiring from wireway at top of frame is not damaged.



Apply Silicone Sealant

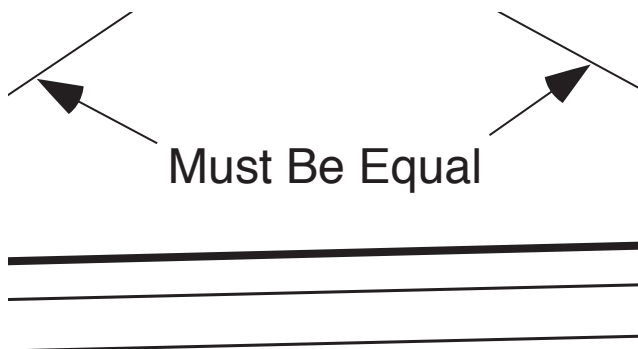

Verify Square Frame

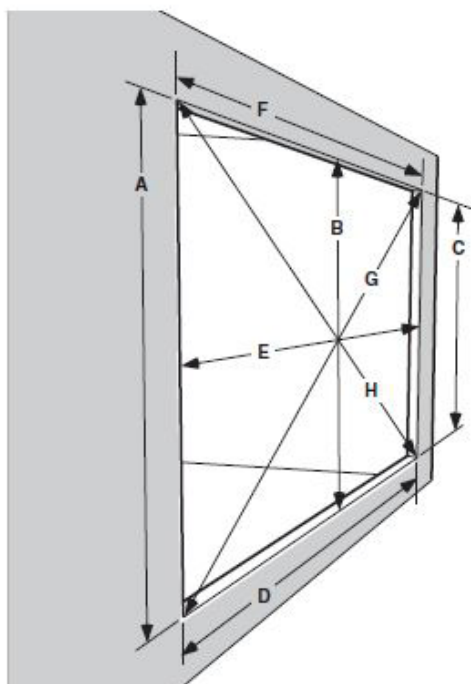

Verify Square and Level Opening



Place Frame in Opening

Innovator Door System

Installation Information

Use the level to ensure the frame is plumb within the opening. Use shims as needed below and to the side to keep the frame level.

Once the frame is properly positioned, large clamps should be used to hold frame in position.




Clamp the Frame



Use the Level

Fasten Frame to Cooler Wall

Use screws provided to fasten the bottom frame to the wall. Fasten side frame to wall with screws. Use shims as necessary. Do not distort frame by excessive tightening. Use low torque when fastening to ensure the frame does not crack.

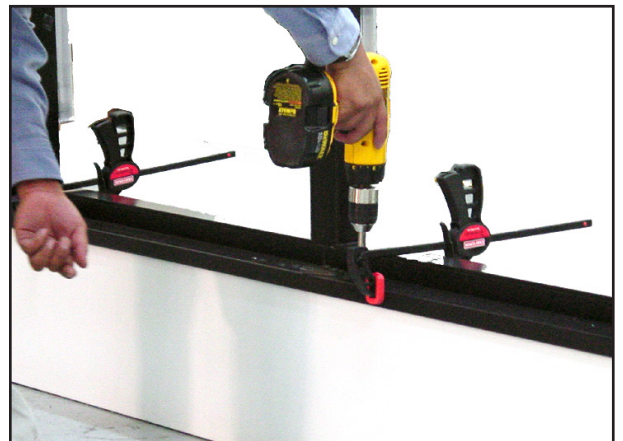

Fasten the Frame Bottom

NOTICE

- » Verify frame is still square. Shims must be used if doors are seated too low or if frame is not square.
- » Use low torque when fastening to ensure the frame does not crack.


Innovator Door System

Installation Information



Fasten Frame to Cooler Wall

Fasten top of frame to wall with screws provided. Do not distort frame by excessive tightening.


Use shims at each screw location to prevent distortion. Once screws are in, verify top of frame is straight and level from side to side.

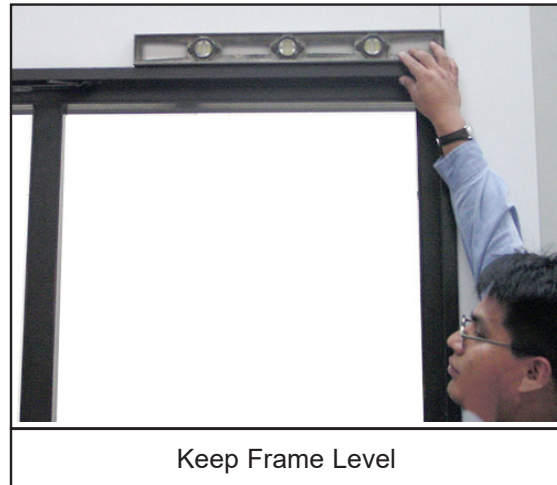

IMPORTANT!
DO NOT OVER-TIGHTEN

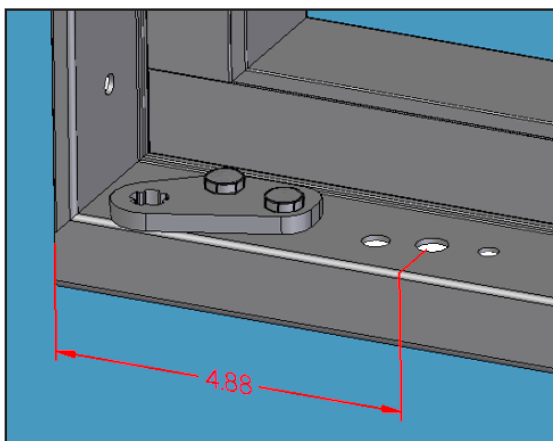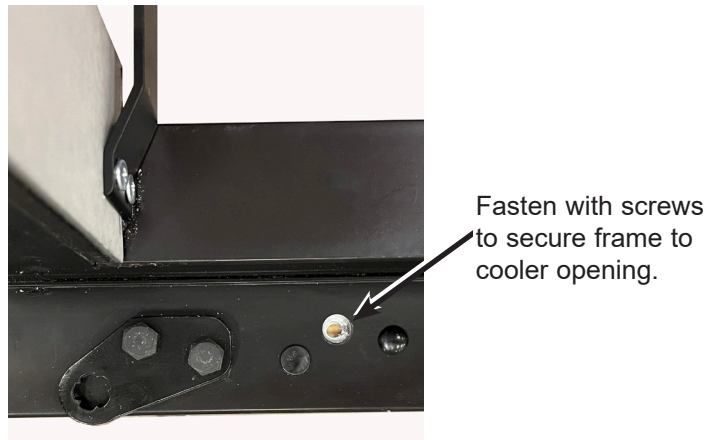

Mounting screw locations at each of the corners, top and bottom. Flange-less end shown, add .75" if flange is present.

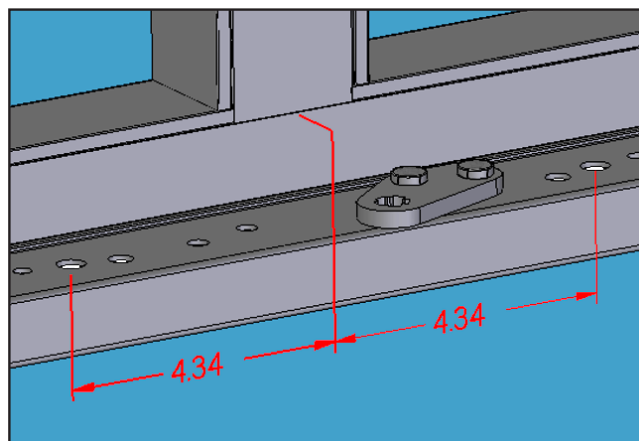

Mounting screw locations at each center mullion, top and bottom.

Innovator Door System

Installation Information

Joining Frames

Frame sides to be joined will have no front face flange. Install the second frame similar to the first frame. Lift the second frame into position and fasten the bottom to the cooler opening. Apply 1 inch-wide gasket between wipes of each frame side that are to be joined together.

Verify the second frame is still square.

If last frame in opening, fasten side frame to cooler wall opening.

Insert 'J' molding between frames.

Fasten frames together with binding post and screw in five locations. Fasten top of frame to cooler wall opening. Do not distort frame sides or top.


Once all frames are installed, verify overall frame is square and plumb.

Seal Inside Frame Perimeter


Apply a small continuous bead of silicone sealant around the inside of the frame to seal the frame to the wall.



Apply Silicone Around Frame

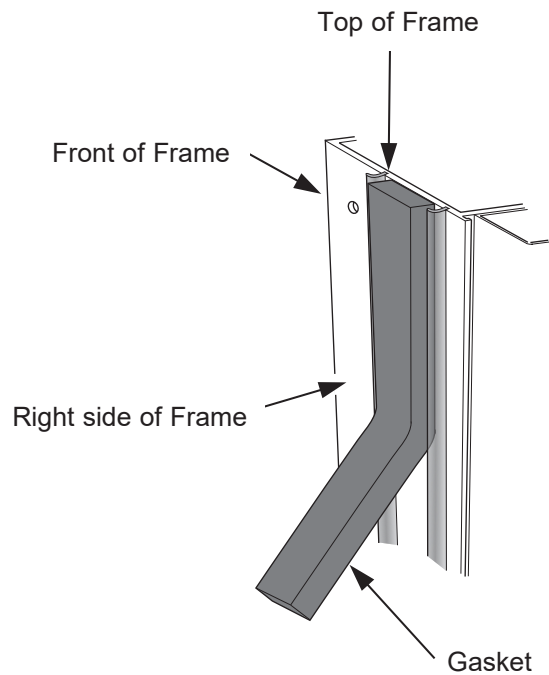

Install Gasket Between Wipes





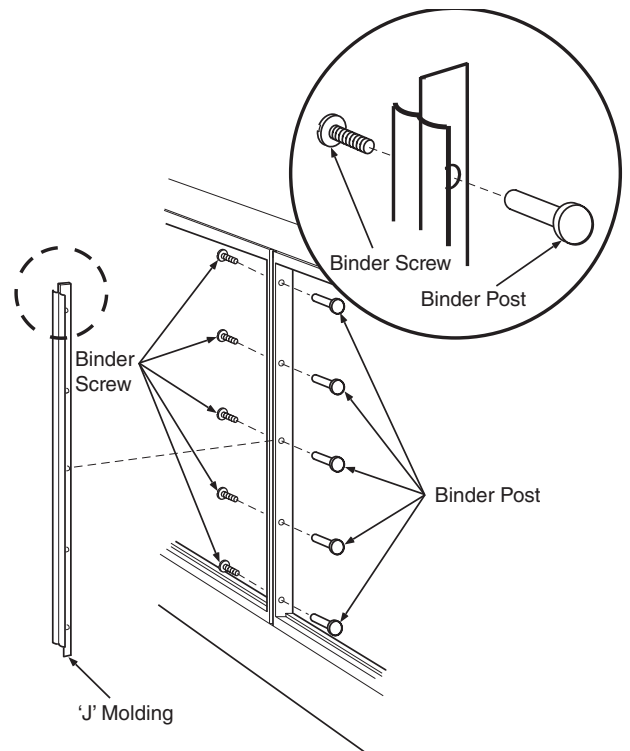


Install 'J' Molding Between Frames

Innovator Door System

Preparation of Mullions and Ends

1. Place the hole location fixture at the corner made by the bottom and the end or mullion.
2. Use the two holes in the fixture as a guide to drill the installation holes in the frame (DO NOT drill further than $\frac{3}{4}$ in).
3. Remove the hole location fixture.
4. Repeat this step for each end and mullion (in mullions only drill to one side, NEVER BOTH).
5. Repeat this step with the corner made by the top and mullion / end.

Parts Description	Images
Bracket Shelf Clip 2x each mullion / end	
Clip Shelf Upright 2x each mullion / end	
Two Shelf Post Joining Assembly Bracket 2x each lineup frame joint (at bottom)	
Screw 10-16 x $\frac{3}{4}$ Philips low profile 2x each bracket shelf clip	
Hole location fixture 1x kit	




Innovator Door System


Frame Shelf Bracket Post Profiles

Below are the orientations and locations for installation of the shelf brackets to the cooler frame.


Left-hand End Frame

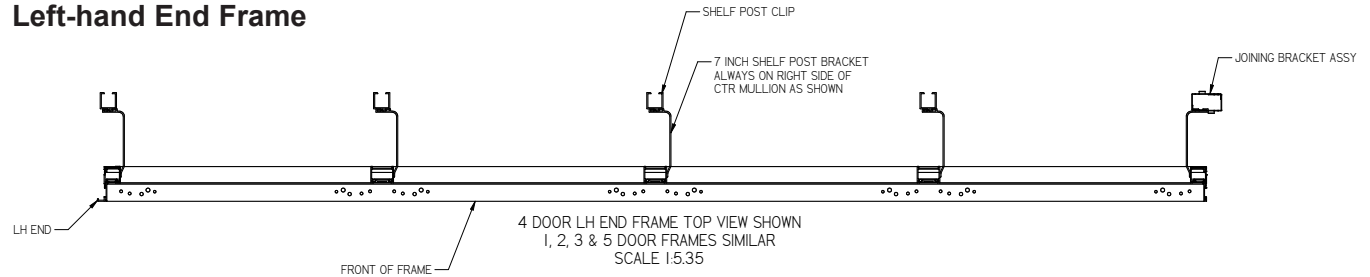


Multi-Frame

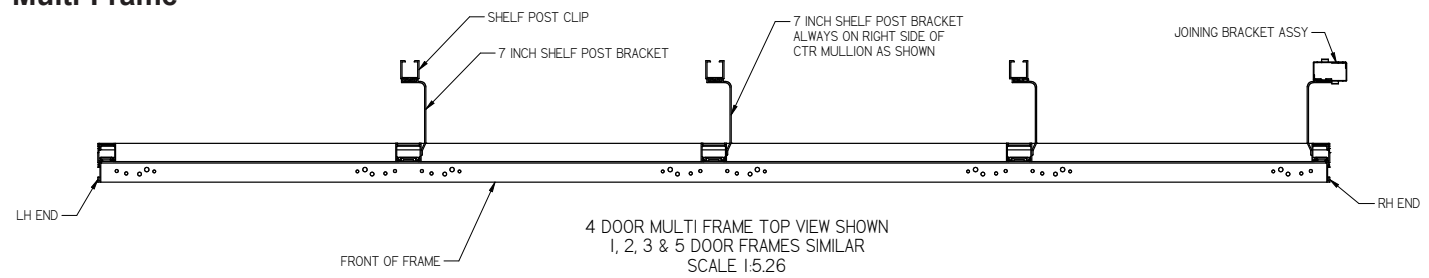

Right-hand End Frame

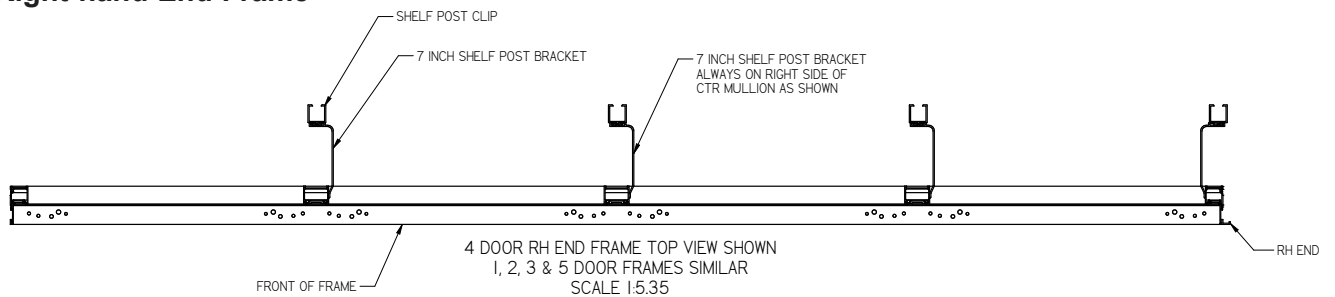

Standalone Frame

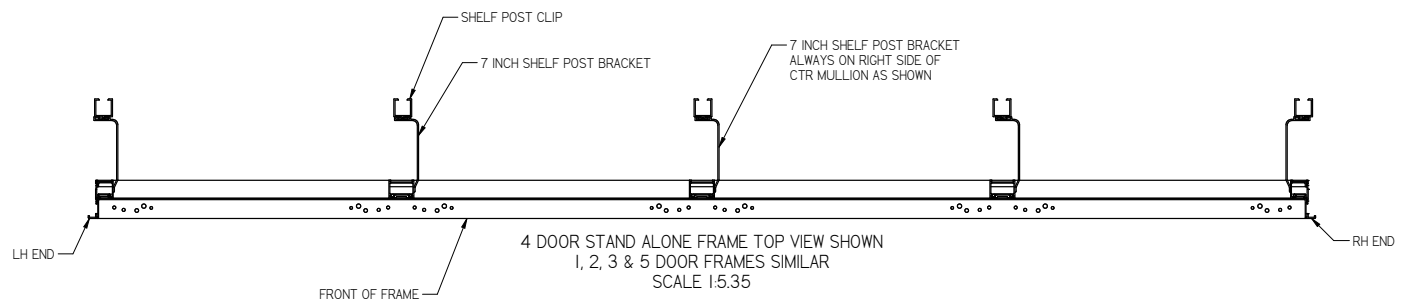

Innovator Door System

Shelf Post Bracket Alignment and Fixing


1. Align the holes of the brackets with the holes made on the mullions / ends.
2. The holes on the mullions / ends should point to the upper & lower edges of the bracket.
3. Use the Phillips screws to fix the bracket to the mullions / ends.
4. Repeat the step for fixing the brackets remaining (two per mullion / end).
5. Next, set the flanges of the shelf post clips and joining brackets into the shelf post brackets. The joining bracket is two separate pieces that snap together.



Shelf Post Bracket Fastened to Top of Mullion



Shelf Post Bracket Fastened to Bottom of Mullion




Joining bracket clips together

SLIP THIS FLANGE INTO SHELF POST BRACKET AS SHOWN

TWO SHELF POST UPRIGHTS SLIDE INTO THIS JOINING BRACKET ASSY

7 INCH SHELF POST BRACKET

DETAIL A
SCALE 1:1.82


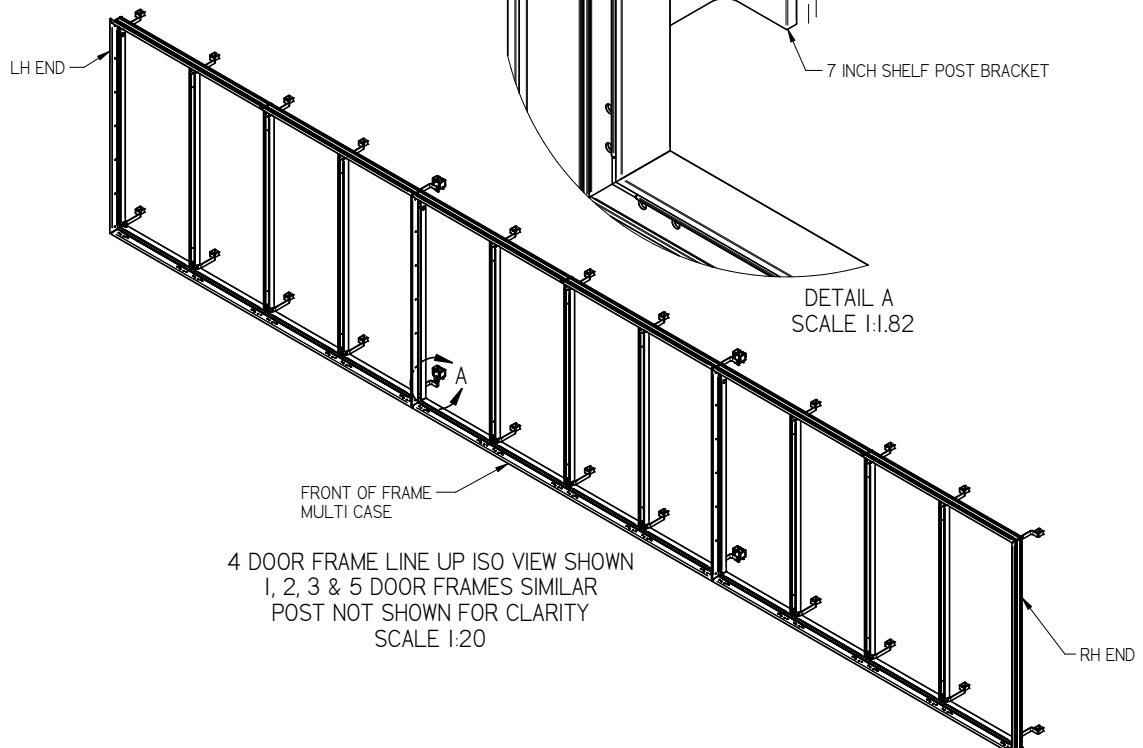


Innovator Door System

Shelf and Post Installation

Once all the shelf joining brackets and shelf post clips are installed, the shelf posts can be installed.


1. Slide the shelf post through the shelf post clips.
2. Slide the posts through the joining bracket clips (two posts for each joining bracket).

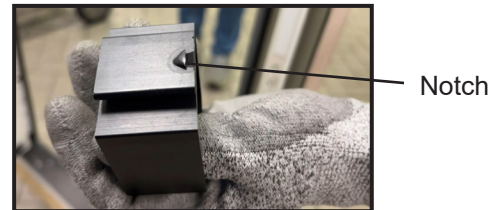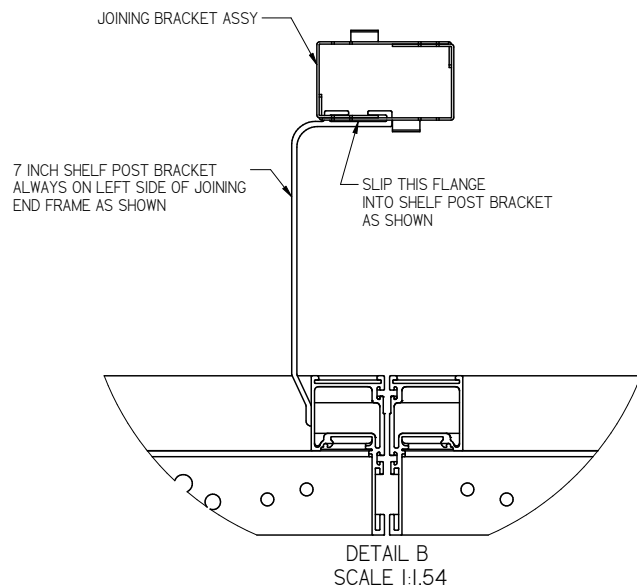

Notch Holds Clip Shelf Upright in Place



Shelf Post Clip Installed

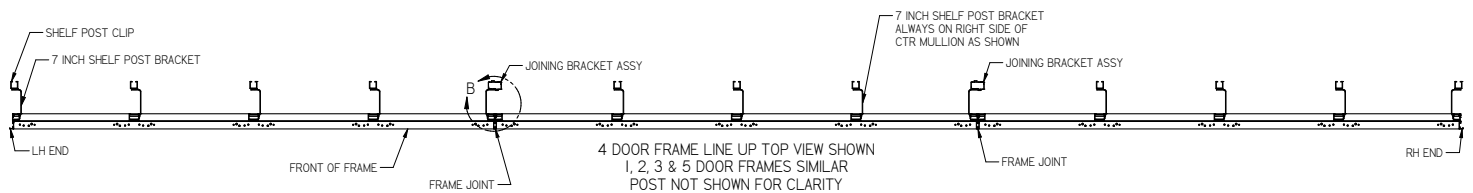


Innovator Door System

Shelf and Post Installation

The shelves fit into the notches at the front and rear of the post uprights.

1. Assemble all the shelves and brackets as shown below (two posts for each joining bracket).

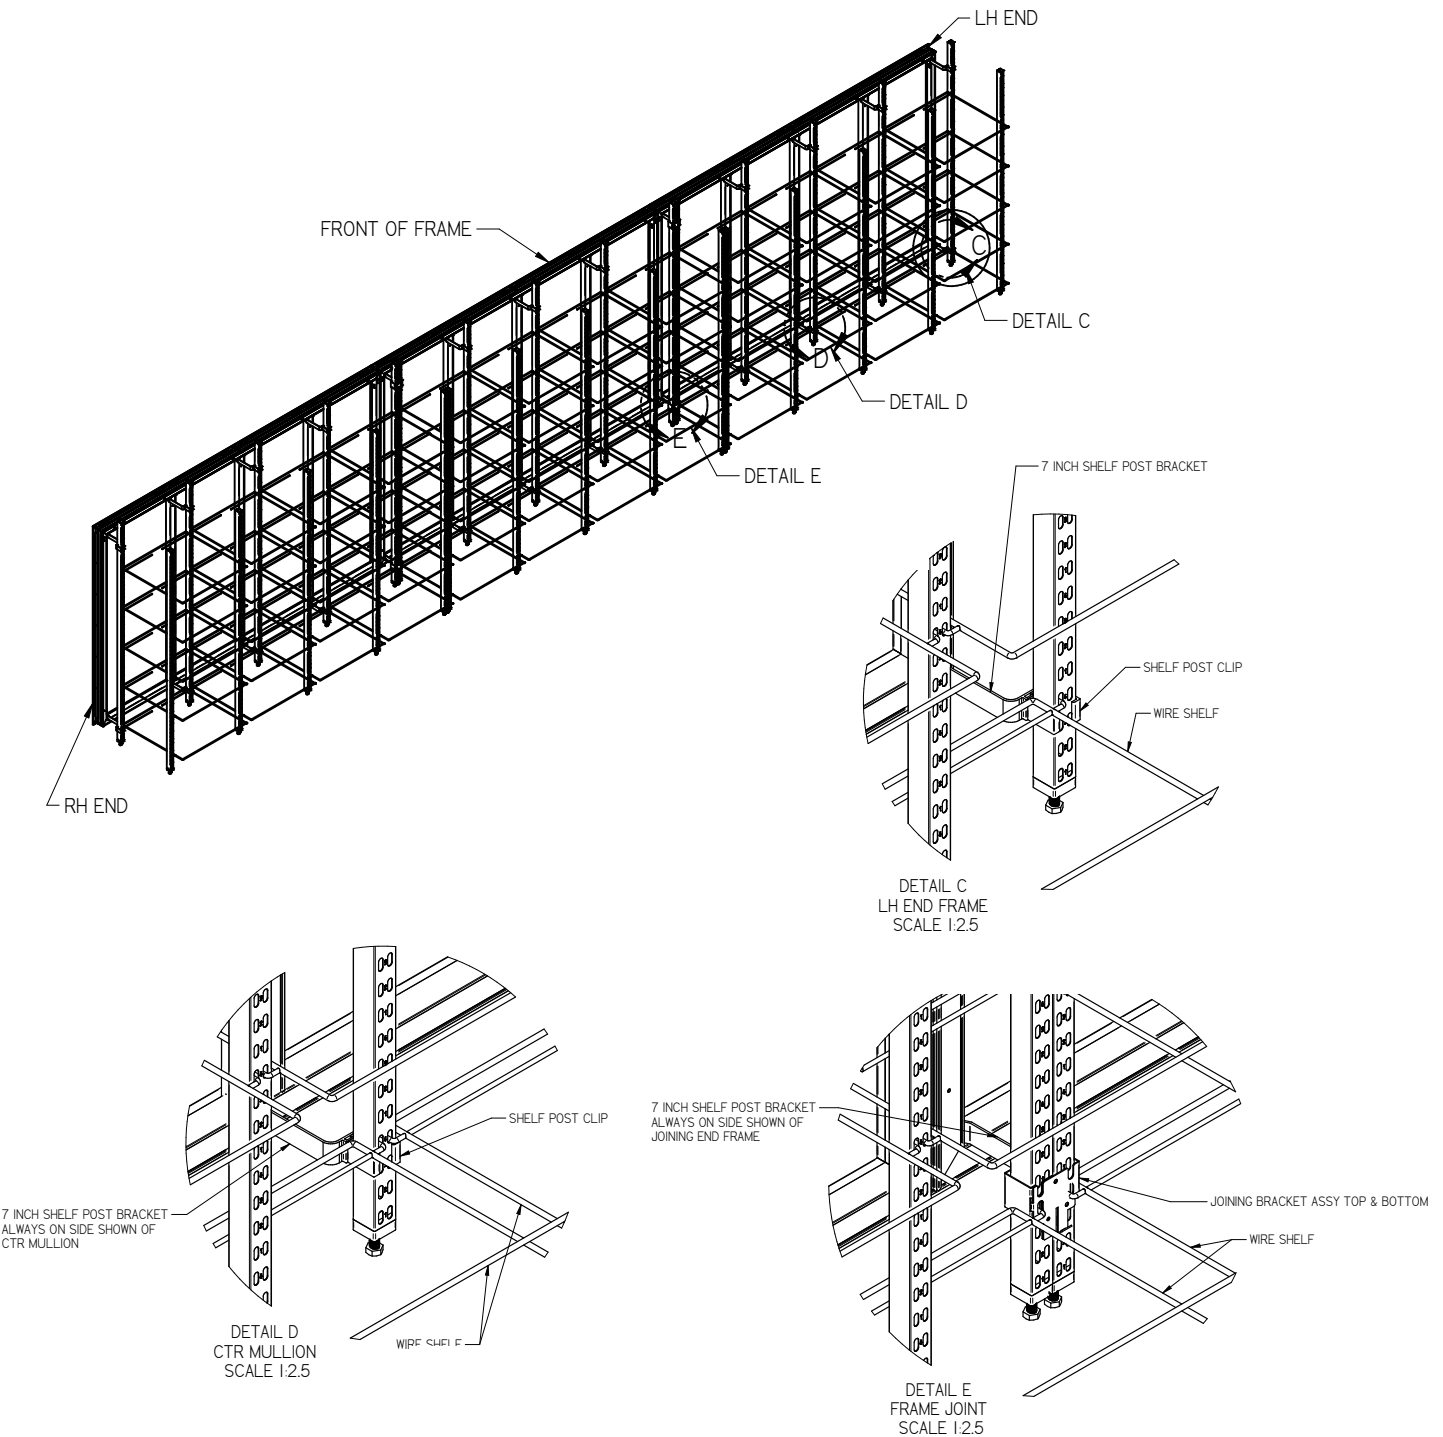

Innovator Door System

Installation Information

Attach Door Handles

Carefully lift the magnetic gasket away from the frame nearest the handle location to expose the mounting screw holes as shown in below.

Install handle and screws carefully (if gasket is damaged, it must be replaced). After installing screws, gasket should again lie flat. If needed, use a mild soap and water solution to lubricate the gasket. Clean and dry the gasket to complete the door handle installation.

Install Doors


Insert the spring, bushing and pin in the top of door. Lift the door and insert the bottom hinge pin into the bottom hinge socket. Rotate the top of the door under the top socket while holding down the top hinge pin. Once the hinge pin is under the top socket, maneuver the door until the hinge pin pops into the socket.




Spring, Pin and Bushing

Ensure the hinge pin is fully engaged into the hinge plate as shown below.

Use a flat blade screwdriver to lift the door retainer over the shoulder screw.

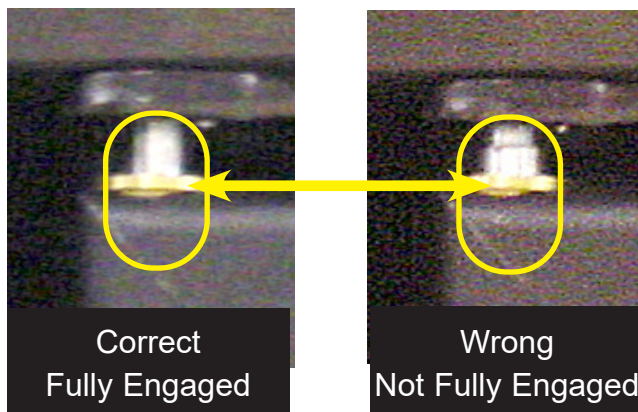

Ensure Hinge Pin is Fully Engaged into Hinge Plate

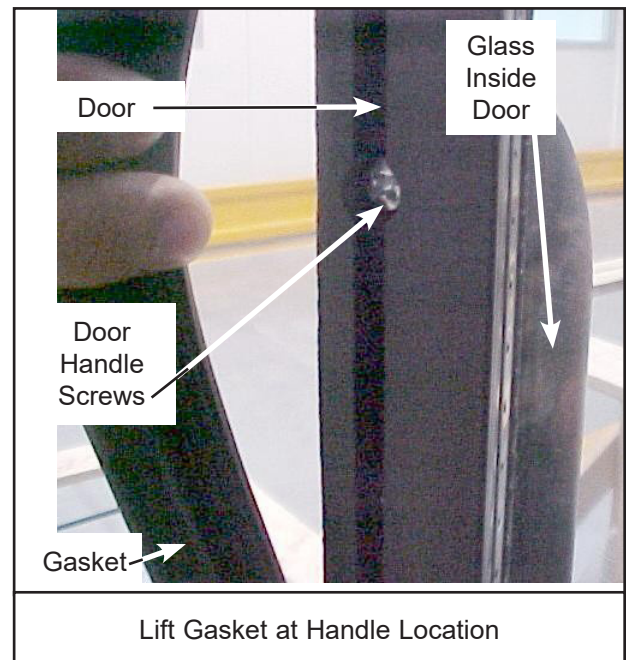

Lift Gasket at Handle Location



Lift Door Retainer Over Shoulder Screw

Innovator Door System

Installation Information

Adjust Closing Torque

Adjust closing torque by turning the bottom hinge pin in the direction the door closes. Use a $\frac{1}{2}$ in. (13 mm) wrench. Turn the hinge pin until the door closes on its own, usually 3 to 4 clicks or $\frac{3}{4}$ turn.

DO NOT over-torque the hinge spring assembly. Excessive torque (over 1 full turn) will result in damage to the spring assembly and/or door. If door does not close on its own after one full turn (5 clicks), look for obstructions causing the door to hang up.




Adjust Closing Torque

Adjust Door Sag

To adjust door sag (saw-tooth effect from door to door), loosen the two hinge plate mounting screws using a Torx Plus no. 27 bit. Adjust hinge plate as needed, then tighten the screws.

Loosen both hinge plate mounting screws (door removed for clarity of illustration).

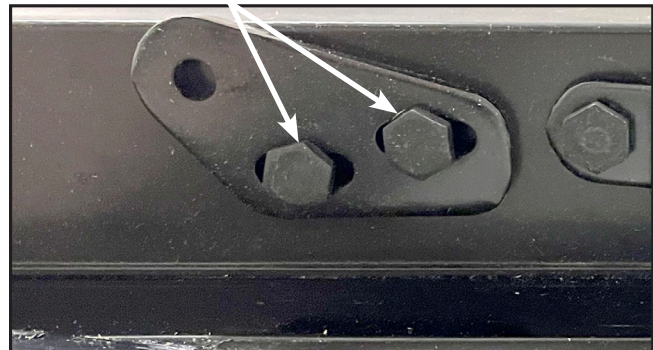

Adjust Door Sag

Innovator Door System

Installation Information

Connect Wiring from Wireway



Door system wiring is routed from the wireway through flexible conduit to be connected to the power source.

Each frame has the following wires in flexible conduit:

- A. The **Door Anti-Sweat Heater Controller Harness** has two separate wires, one black and one white wire.
- B. The **LED Power Supply Harness** has one white wire and one black wire bound with tie wrap.
- C. The **Ground** wire is green.

The photo below shows the wiring with labels added for clarity.

Each frame is connected to field wiring at a handy box. Frames must not be wired in series. All wiring must be done in accordance with NEC and local codes.

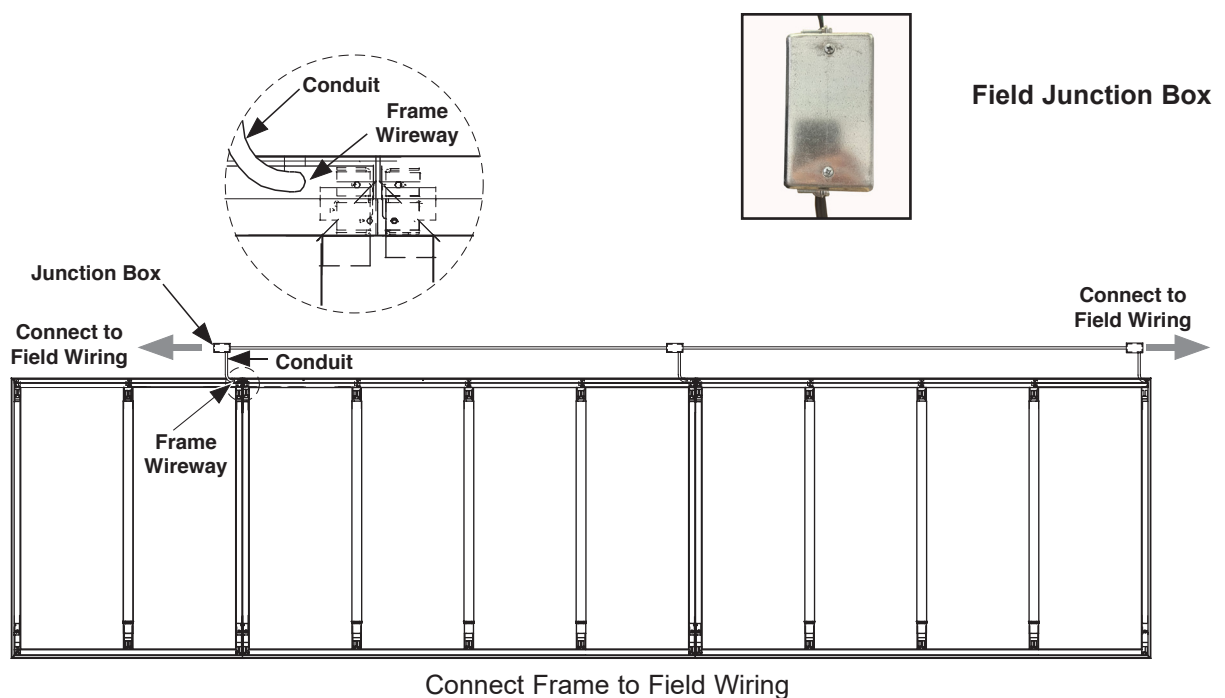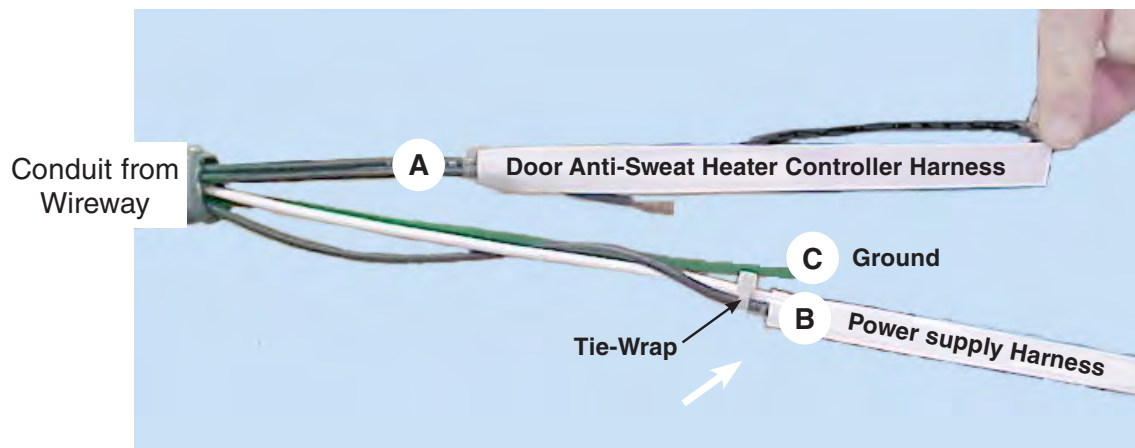

Innovator Door System

Installation Information

Conditioning Gaskets

In the factory environment, gaskets can be fitted to seal properly. However, the manufacturer cannot control the environment surrounding components during shipment or installation. Temperature and humidity fluctuations promote gaps which prevent sealing between gasket and frame. This is not a warranty issue or defect. Before refrigerating the walk-in space, follow this procedure which was developed to ensure gaps close and gaskets seal properly in most environments.

1. Install the frames and doors, connect all wiring, and make adjustments as directed in the preceding pages.
2. Close each door. Use a flashlight to identify any gaps between frame and gasket.
3. Energize all anti-sweat, fan and light circuits for at least two hours, but not more than four hours, prior to initiating the refrigeration cycle.
4. Monitor all gaps.
5. Initiate cooling sequence after four hours or once the gaps disappear, whichever comes first.

If gaps remain at the end of four hours, follow the procedure for Restoring Gasket Seal.

NOTICE

- » To ensure proper door gasket seal - Install doors and frames, then energize all anti-sweat and light circuits 2 to 4 hours prior to initiating refrigeration cycle.
- » Do not exceed 8 hours of energized circuits without refrigeration. Damage or product failure may occur and void the warranty.

⚠ WARNING

- » Always disconnect the electrical power at the main disconnect when servicing or replacing any electrical component. This includes, but is not limited to, such items as doors, lights, fans, heaters, and thermostats.

Innovator Door System

Installation Information

Restoring Gasket Seal


Occasionally, a crimped or damaged gasket can cause gaps in the seal, leading to frost formation on the doors. Use this procedure to close gaps and end frost formation on doors.




Improperly Installed or Damaged Gasket

Locate Gaps

Normally, interior ambient lighting will provide enough light to see gaps. In some cases, the only way to see gaps is to provide a backlight as shown (A). Backlight the door mullion and look for places the light shines between the door and gasket, (B).

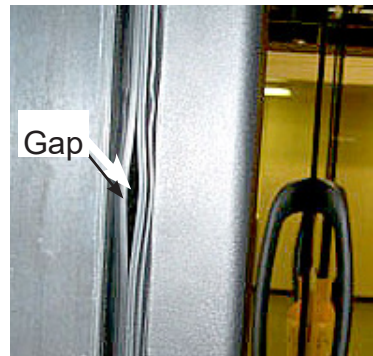

(A)

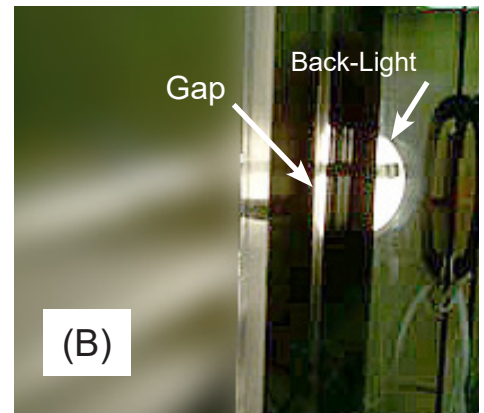

Back-Lighting Gaps in Gasket

Heat the Gasket

Make sure the door is closed. Beginning at the top of the gap, use a heat gun or electric hair dryer (1500-1600 watt) to heat the gasket with a constant up and down motion.

IMPORTANT:

If a gap runs the entire length of the door, heat the area 4 in. (100 mm) above and 8 in. (200 mm) below the top-most point where the gap starts and work in 12 in. (300 mm) increments.



If the gasket becomes shiny, remove heat immediately as this is an indication that the gasket is near the melting point.

Innovator Door System

Service and Repair

Replacing Doors

1. Loosen torque on door before removing the door. Wedge a screwdriver between the bottom of the door and the hinge socket, then lift the door up. This will lift the bottom hinge pin up and out of the bottom hinge socket. Hold the hinge pin with a ½ in. (13 mm) open end wrench to keep it from spinning out and stripping the socket.
2. Use a flat blade screwdriver as shown to lift the door retainer over the shoulder screw.
3. Push down the spring-loaded top hinge pin until it clears the top socket using a flat blade screwdriver. With finger, hold the hinge pin in the door to keep it from popping out. Tape may be used to temporarily hold the hinge pin once door is removed.
4. Rock the door out and pull the bottom hinge pin out from the bottom socket.
5. Install the new door in reverse order.
6. Adjust the torque on the new door. If needed, adjust sag.

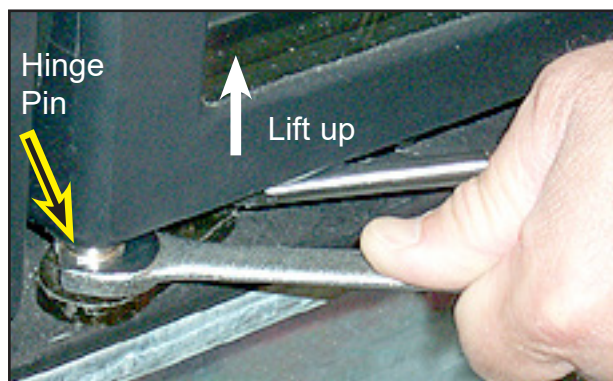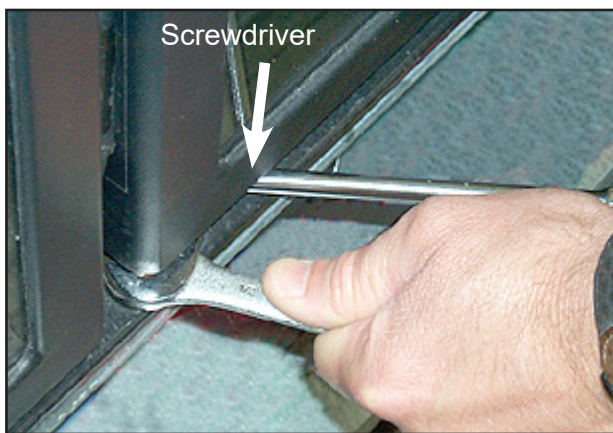

Loosen Torque on the Door



Remove Top Hinge Pin from
Top Hinge Socket

Innovator Door System

Service and Repair

Replacing Door Hinge Spring

The door must be removed before replacing the door hinge spring. Pull the hinge spring assembly out of the bottom of the door and replace with a new assembly. Note that there are right-hand and left-hand hinge spring assemblies.

Replacing Magnetic Gasket

Carefully remove the old gasket from the groove in the back of the door. The new gasket will be easier to work with if it is at ambient temperature. Begin by lubricating the new gasket with a mild soap and water solution.

Work from the corners to the centers of each side, top and bottom. Carefully push the new gasket into the groove at each corner, refer to sequence (A). Then, push the gasket into the channel at the center of the top, bottom and each side, (B). Avoid stretching the gasket.

Sub-divide remaining areas and push the gasket in at those points, (C).

Sub-divide once again and repeat pushing the gasket in until all of the gasket is evenly seated in the groove, (D).


Use a soft cloth or paper towels to dry the gasket before closing door on clean door frame.



Replace Door Hinge Spring



Remove Door Gasket

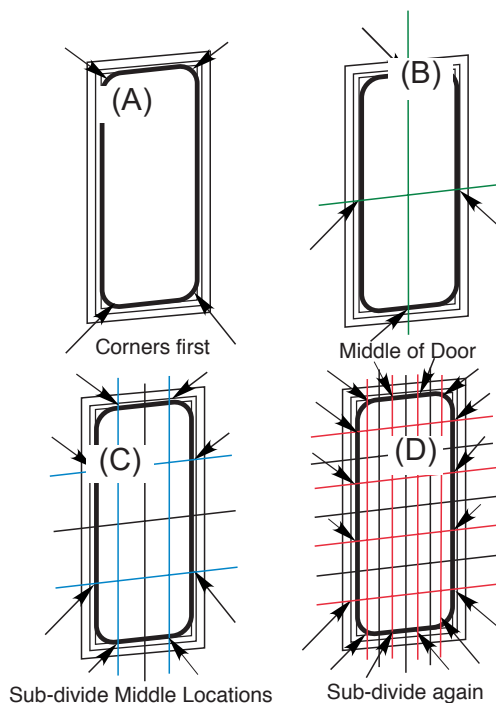

Sequence for Installing New Gasket

Innovator Door System

Service and Repair



If possible, direct the hot air onto the gasket and also through the gap between the gasket and mullion. This will help to heat both sides of the gasket.

As the gasket softens and becomes pliable, the magnet in the gasket should pull it across the gap. As the gap closes, move heat down to create a zippering effect as shown.


If the gasket is not pulled across the gap by the magnet, reach around the mullion (from the inside) and pull the gasket skirt toward the mullion.

This can also be accomplished by pushing the magnet across the gap from the outside with a pencil or other non-heat conducting material.

On doors where the gap is against an end, top, or bottom mullion, this process can still be done; however, the heat will need to be directed between the lip of the mullion and the edge of the door. It will work in the same fashion but the back-light shining through and showing on the mullion will have to be a guide as to the position of the gasket.

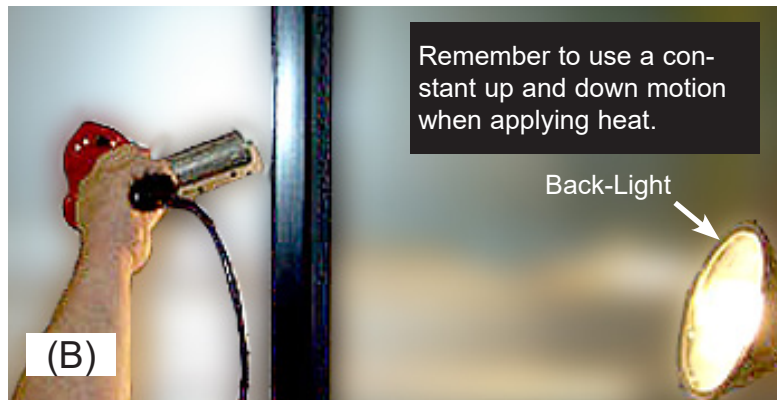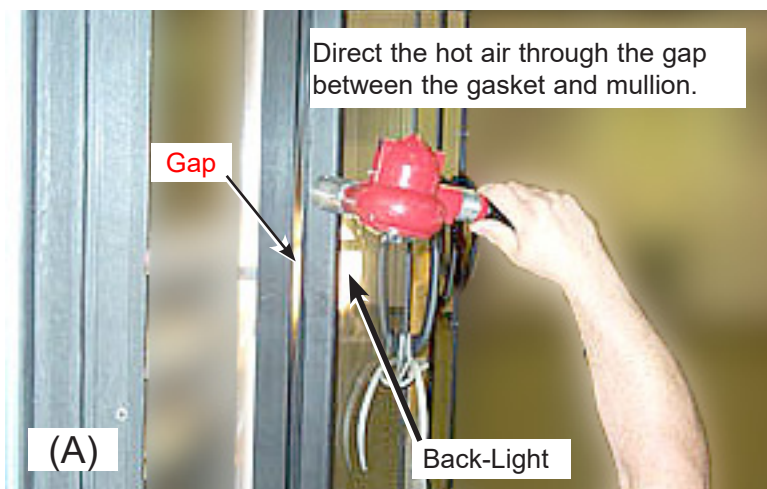

Applying Heat to Gasket

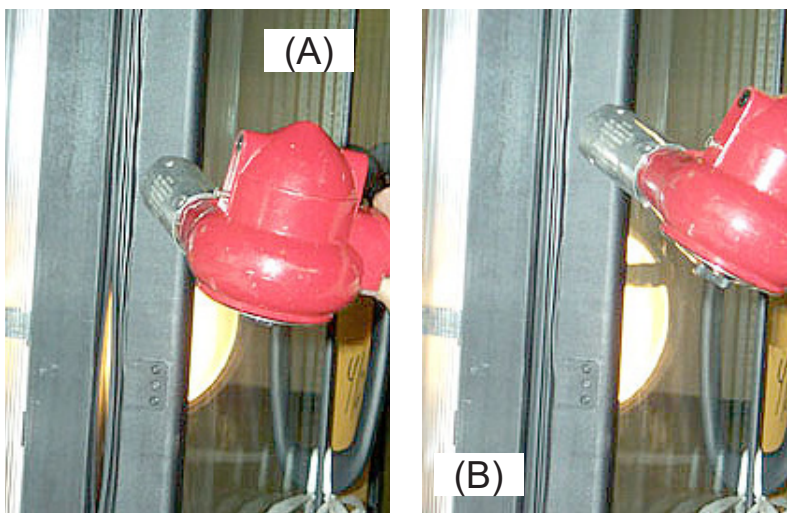

Zipper Effect

Innovator Door System

Service and Repair

Cool the Gasket

Once the gap is closed, remove the heat and allow the gasket to cool, undisturbed, for 3 to 5 minutes. As the gasket cools, it will set permanently in this new shape.

Once the gasket is cool to the touch, open and close the door. Verify that the gasket seals. If not, repeat the process. If the gasket rolls it must be replaced.

Use a soft cloth or paper towels, and a mild soap and water solution to thoroughly clean the gasket. Dry the gasket completely with a fresh cloth or paper towels before closing the door on a clean door frame.

Door Handle Replacement

Carefully pull the magnetic gasket away from the glass nearest the handle to expose the mounting screws as shown. Remove the screws and replace the handle. After reinstalling screws, carefully push gasket back into place. If needed, use a mild soap and water solution to lubricate the gasket. Clean and dry the gasket to complete the door handle replacement.



Mounting Screws



Pulling Gasket Into Place With a Pencil



Replacing Door Handle

Innovator Door System

Service and Repair

LED Fixture



LED lights work well for dimming or on/off operation using an occupancy sensor (optional kits). They can be turned on and off in a cold environment with no warm-up time and no negative impact on lamp life.

LED Fixture Replacement


1. Remove product from the cooler and store appropriately.
2. Remove the wire racks from the cooler. Store them out of the way of customers and store personnel.
3. Turn the light switch to OFF. The switch is located inside the cooler on the door mullion.
4. Lock out and tag out the circuit breaker for the lighting circuit of the cooler where the LED fixtures are installed.
5. Disconnect fixture wiring. Tag cooler wiring with color of fixture wire color connected. LED lighting is polarity sensitive.
6. Remove Fixtures.
7. Reassemble in the reverse order of disassembly.

NOTE:

LED light fixtures are polarity sensitive. The power supply positive wire must be electrically connected to the red wires of the LED fixture. The power supply negative wire must be connected electrically to the black wires. See Wiring Diagrams.

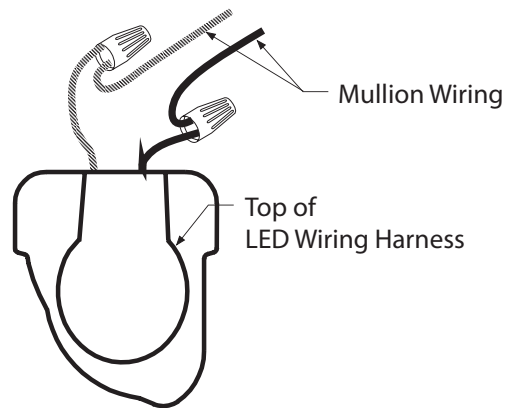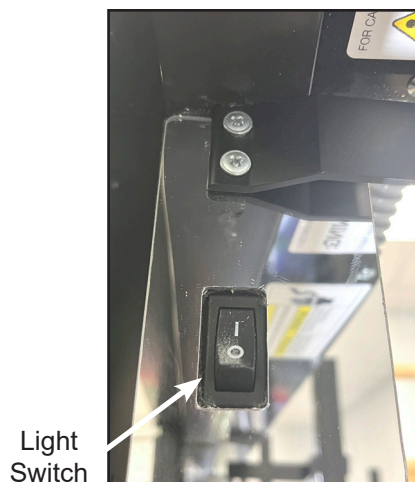

Disconnect Wiring
(Center Fixture Shown, End Fixture Similar)

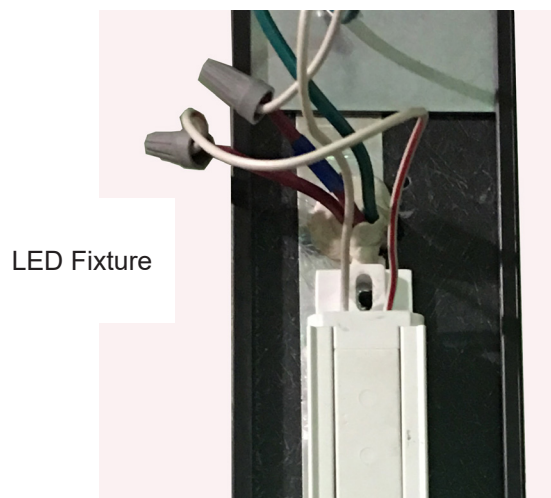

Innovator Door System

Service and Repair

Remove Protective Film


Often, an LED fixture is shipped with a protective film over the lens, as shown in Figure 1. Remove and recycle the film.

LED Power Supply Replacement

Shelves will need to be removed as necessary to access the raceway. Power supplies are located in the raceway above the door frame. To access the raceway, remove the bumper, then remove the #8 hex head screws that hold on the front painted panel.




Figure 1. Interior View of End Fixture

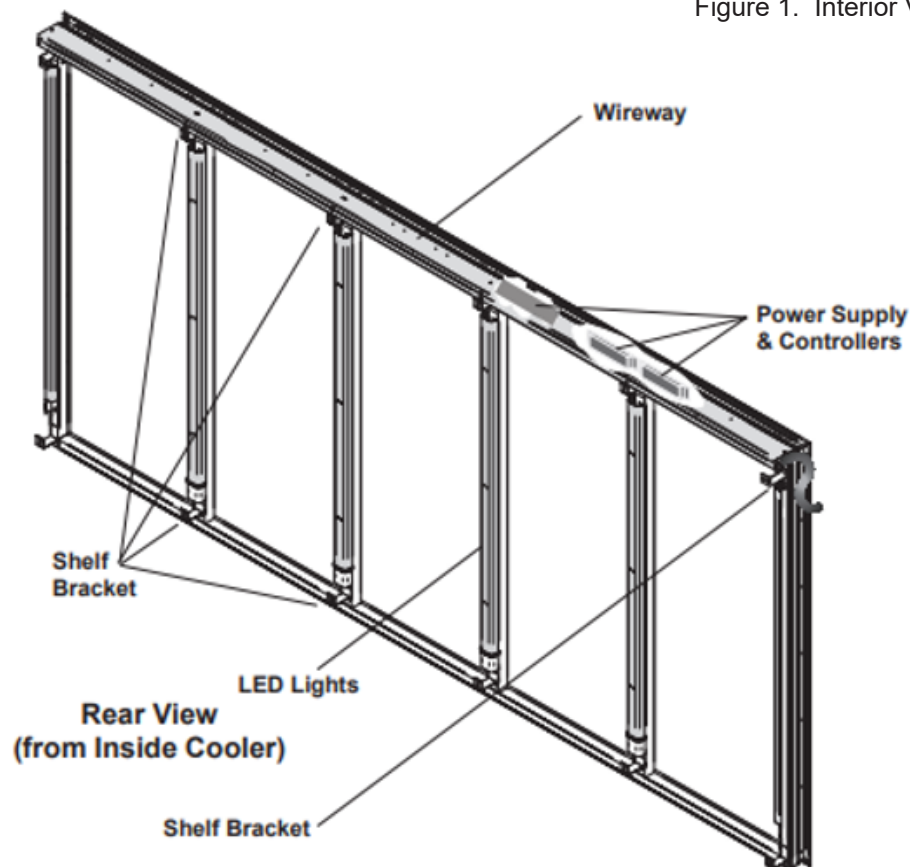

⚠ WARNING

» — LOCK OUT / TAG OUT —

» To avoid serious injury or death from electrical shock, always disconnect the electrical power at the main disconnect when servicing or replacing any electrical component. This includes, but is not limited to, such items as doors, lights, fans, heaters, and thermostats.

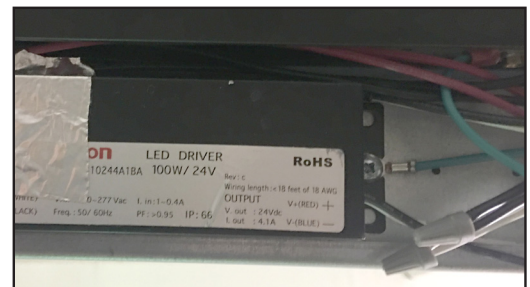


Innovator Door System

Service and Repair


Frame Heater Replacement

Always turn off power to the unit before working on any electrical components. The old wireway covers must be removed to access the door frame heaters. Begin by inserting a putty knife into the groove between the wireway cover and fiberglass frame, about an inch (25 mm) away from joints in the frame as shown in (A). Carefully begin to pry off the cover.

As shown in (B), use a second putty knife or flat head screwdriver to hold up the cover. Pry the remainder of the section up, using putty knife only, until the entire cover is off and the frame heater inside the door frame is exposed.

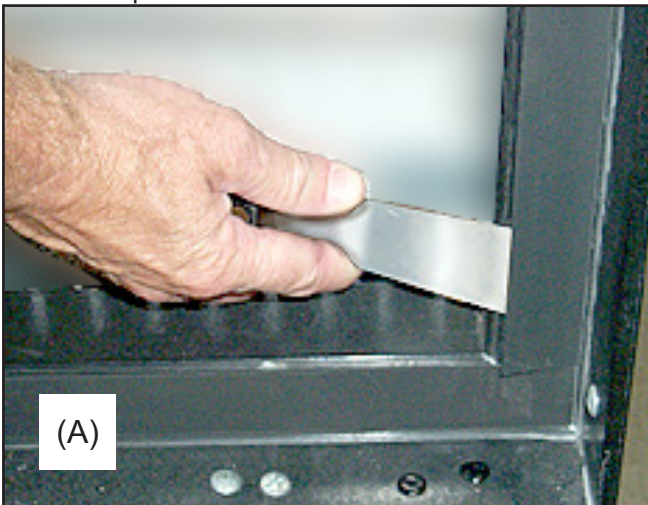


Door frame heaters may now be replaced. During installation, the white portion of the heater should not come in contact with itself. The heater should be installed so that only one white portion of the wire enters the wireway. The other portion entering the wireway will be the black lead wire.

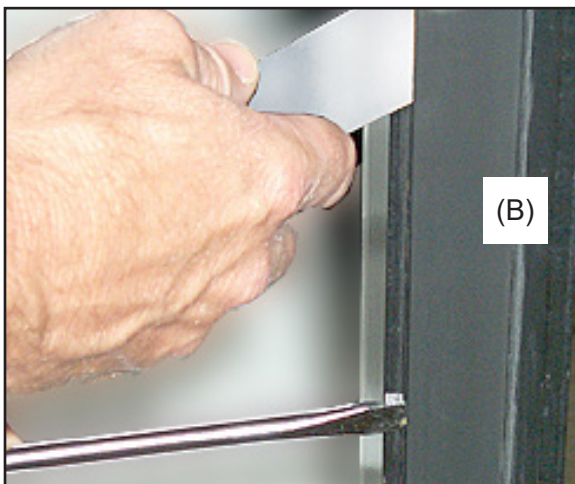

Remove Wireway Cover

Once the heater wire is connected, check resistance (ohm reading) before replacing wireway covers. This will ensure that heater wire was not broken during installation. After covers are reinstalled, turn power on and verify that heaters are working properly.

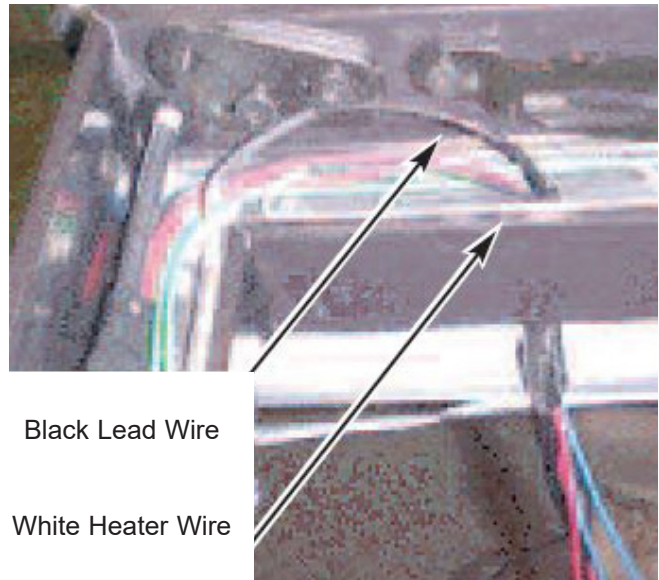

White Heater Wire

Remove and Replace Frame Heater

Innovator Door System

Dimmer Control

(Optional) Dimmer

The LED Dimmer Control regulates the brightness of the LED lighting. A passive infrared motion detector located on the top front center of cooler door frames or on the wall for wall mounts, detects the presence of approaching customers.

NOTE:



The motion detector is available in gray, black and pearl.

A signal is passed to the dimmer control, which is connected to the LED lighting power supply.

The dimmer control receives a signal from the motion detector and adjusts the brightness of the merchandiser's LED lights accordingly.

The amount of LED brightness emitting from the merchandiser lights can be modulated from 100% to 0%, 20% or 50% as selected by the installer. The Motion Activated Dimmer Control regulates the application of power to the LED lighting and is powered by a LED 24VDC power supply.

Dimmer Control is factory set to 20% minimum LED brightness.

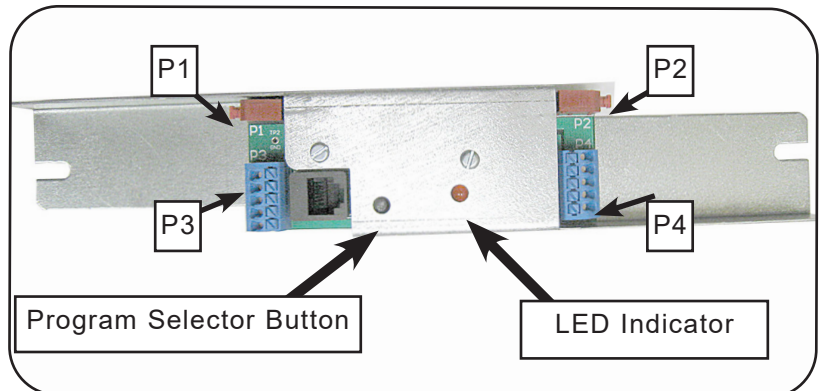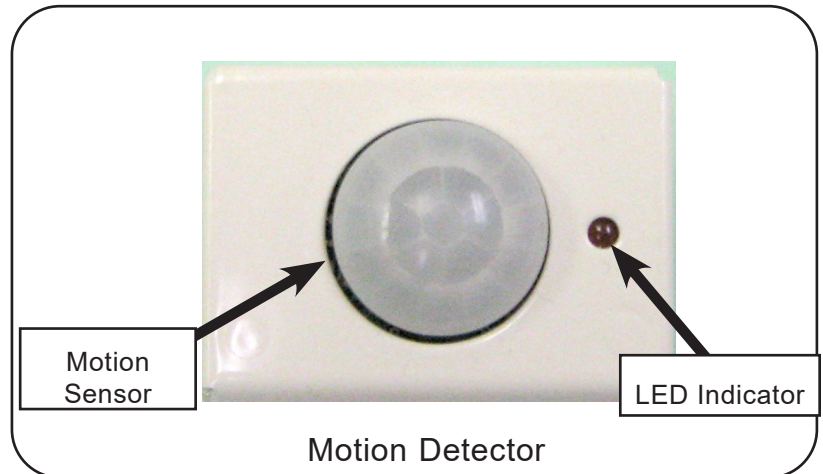

⚠ CAUTION

- » Do not use dimmers to control receptacles or fluorescent lighting fixtures.
- » Fire Hazard: Dimming non-dimmable devices can cause overheating, malfunction, or even electrical fires.

Innovator Door System

Dimmer Control


Dimmer Operation

When power is first applied to the Motion Activated LED Dimmer Control, The LED Indicator flashes two times and the LED lights are set to dim at 20%. The dimmer control can be set to dim the LED lights to 0%, 20% and 50% respectively.

The dimmer level remains at 20% for five seconds, and is then elevated to 100%. After one minute, the motion detector “learns” the background environment. During this time, the output will remain at 100%. If no motion is detected after 30 seconds, the LED brightness will dim to the selected output minimum from the dimmer control.

This dimming takes place over a period of three seconds as the lighting is reduced from 100% to the selected minimum as programmed on the dimmer control. The minimum setting can be set to 0% (off), 20% (default setting), or 50%.

When motion is detected again, the LED brightness will increase to 100% over one second. Lighting will again remain at 100% until 30 seconds of no detected motion.

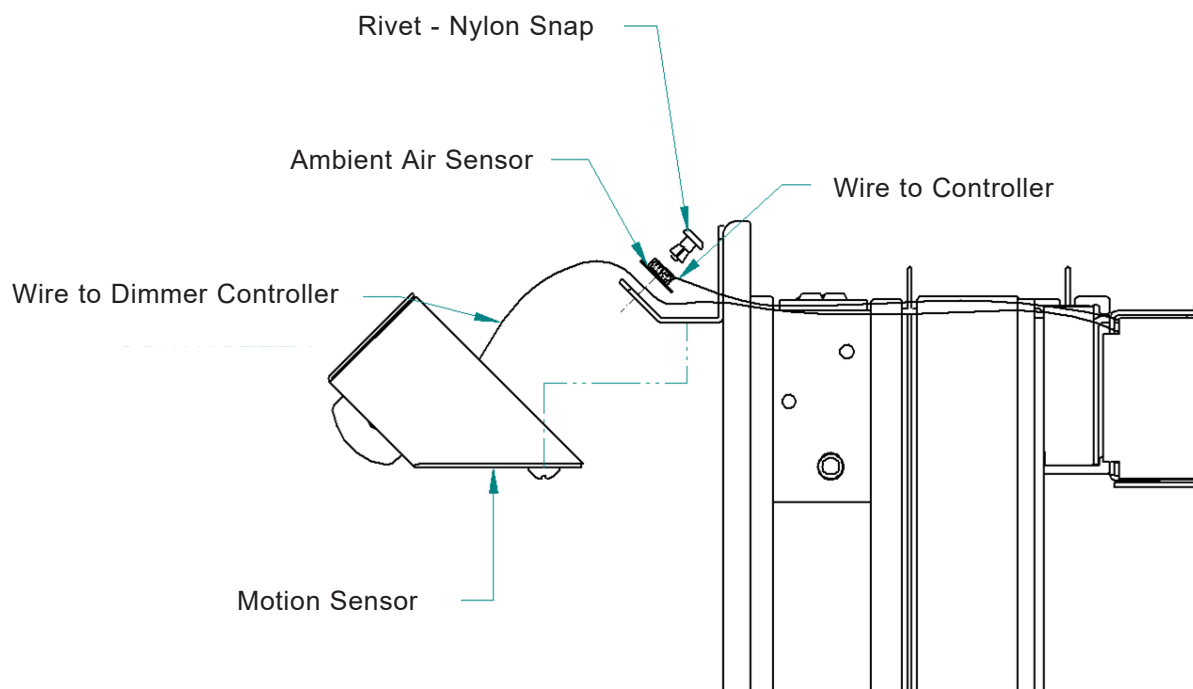

Innovator Door System

Dimmer Control

Program Dimmer Control

The Motion Activated LED Dimmer Control is factory installed and set to 20% minimum LED brightness. The dimmer control is located at in the center of each door frame.

Locate the dimmer control. Press and hold the program selector button on the dimmer control for three seconds. This enters the Motion Activated LED Dimmer Control's program mode. The LED on the dimmer control will flash four times.


From program mode, press the program selector button one time, and the LED on the dimmer control will flash one time. LEDs will turn off. The case LED lights are now set to dim to **0%** minimum.

From program mode, press the program selector button twice, and the LED on the dimmer control will flash two times, LEDs will illuminate to 20%. The LED lights are now set to **20%** minimum.

From program mode, press the program selector button three times, and the LED on the dimmer control will flash three times. LEDs will illuminate to 50%. The LED lights are now set to 50% minimum. Program mode times out after 30 seconds. (This is the only way to exit program mode.) After 30 seconds, the case LEDs will illuminate to 100% to indicate exit from program mode.

NOTE:

Dimmer Control is factory set to 20% minimum LED brightness.

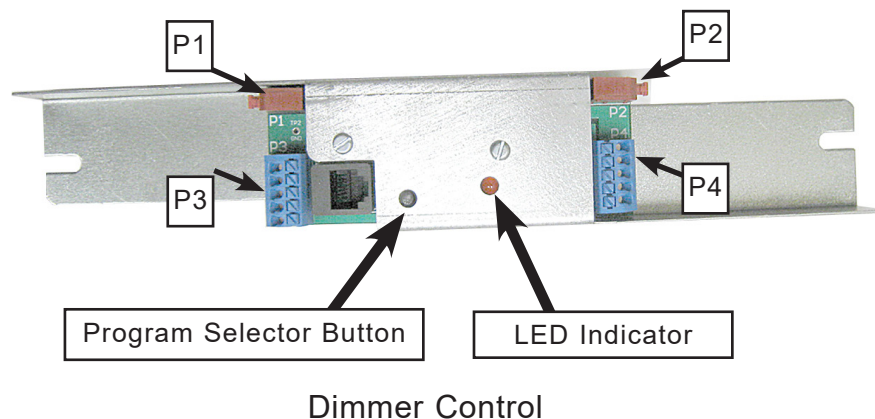


Motion Detector Switch

A switch on the top rear of the motion detector has two settings ON and DIM.

When the switch is set to ON, the merchandiser LEDs will power to 100%, bypassing the motion sensor.

The motion sensor will operate normally when the switch is set to DIM.

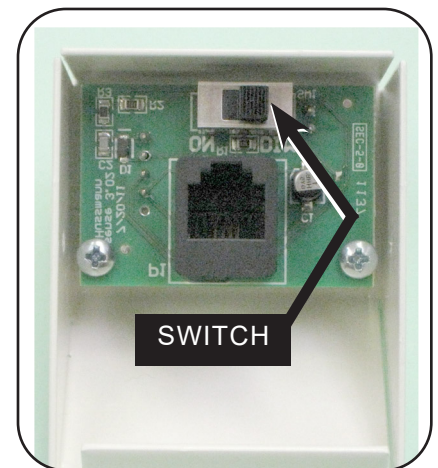

Dimmer Switch in "DIM" position.

NOTE:

Do not paint motion detector. Painting motion detector may cause overheating, or loss of motion sensing capability.

Do not mount motion detector in outdoor areas.


Innovator Door System

Dimmer Control

Dimmer Control Troubleshooting


Problem	What to Check for	Possible Causes	Solution / Action
Case LEDs stay at 100% after one and a half minutes of operation.	LED Indicator on Motion Detector is "ON." Dimmer Control LED Indicator is lit.	Dimmer Control has a startup delay of about one and a half minutes, and the Motion Sensor had not warmed up.	Wait more than two minutes for Motion Sensor to dim to programmed setting on Dimmer Control.
Case LEDs stay at 100%.	LED Indicator on Motion Detector is "ON." Dimmer Control LED Indicator is lit.	Sensor sensing motion.	Ensure all objects remain motionless in the view of Motion Detector for more than 30 seconds.
Case LEDs stay at 100%.	LED Indicator on Motion Detector is "ON." Dimmer Control LED Indicator is lit.	Switch on Motion Detector is in the "ON" position, bypassing the Dimmer Control.	Move Motion Detector switch to "DIM" position.
Case LEDs stay at 100%.	LED Indicator on Motion Detector is "ON." Dimmer Control LED Indicator is lit.	Dimmer Control is wired backwards.	Wire Power Supply to the Dimmer Control input and the LEDs to the Dimmer Control output.
Case LEDs stay at 100%.	LED Indicator on Motion Detector is "OFF." Dimmer Control LED Indicator is lit.	RJ-11 connector is not properly seated or bad RJ-11 Connector Cord.	Install new RJ-11 Connector Cord.
Case LEDs stay at 100%.	No motion is present. Dimmer Control LED Indicator flashes at 1-second interval.	Bad Dimmer Control.	Install new Dimmer Control.
Case LEDs stay at dimmed level.	Motion Detector detects no motion. LED Indicator on Motion Detector is "OFF." Dimmer Control LED Indicator flashes at 1-second interval.	Bad Motion Detector.	Install new Motion Detector.

Wiring Diagram

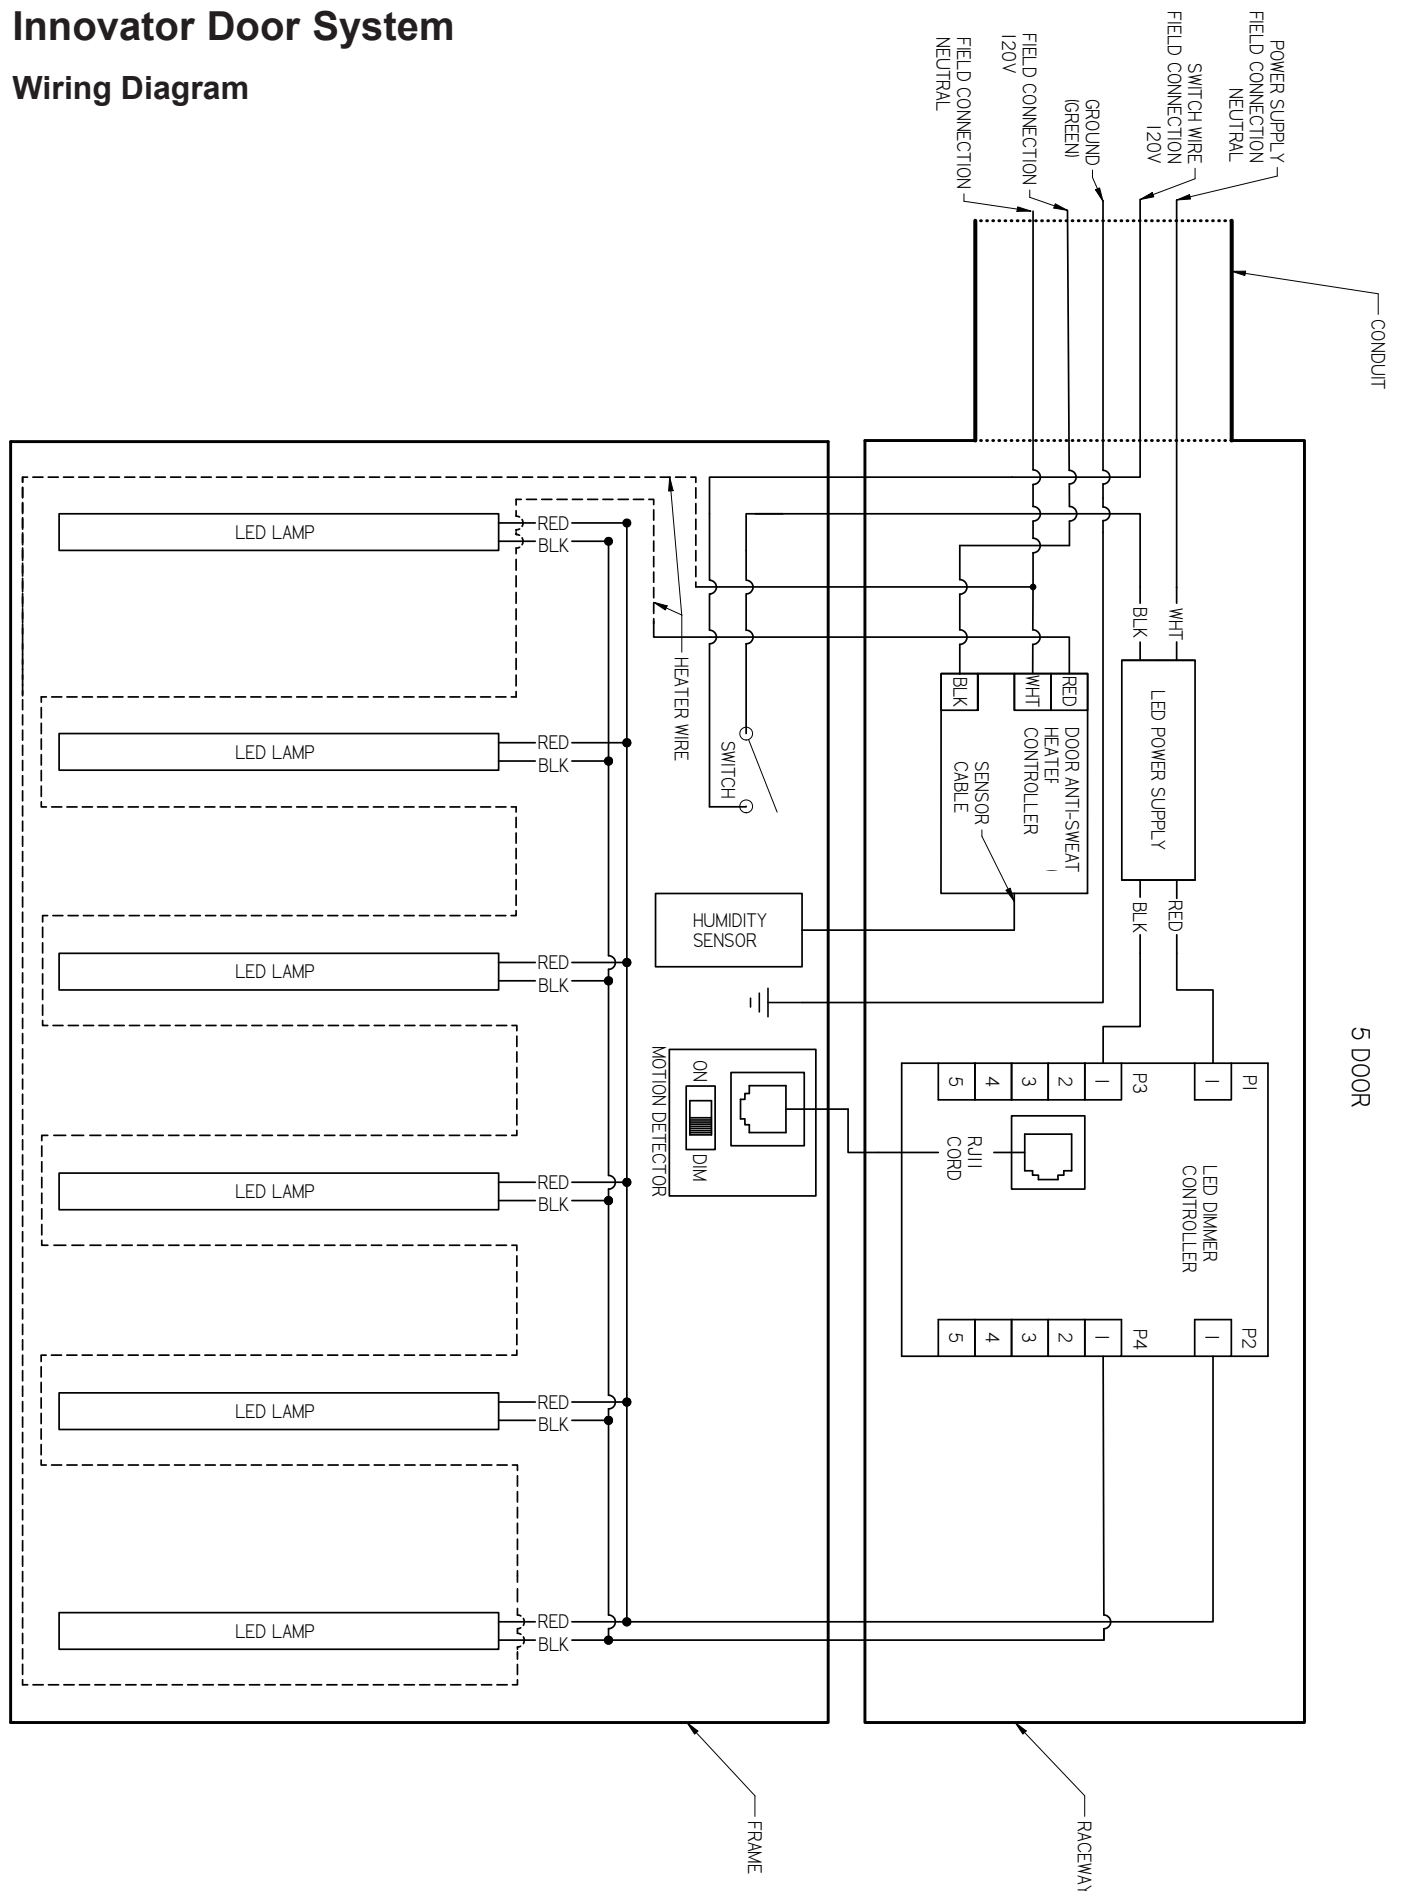

Innovator Door System



Replacement Parts

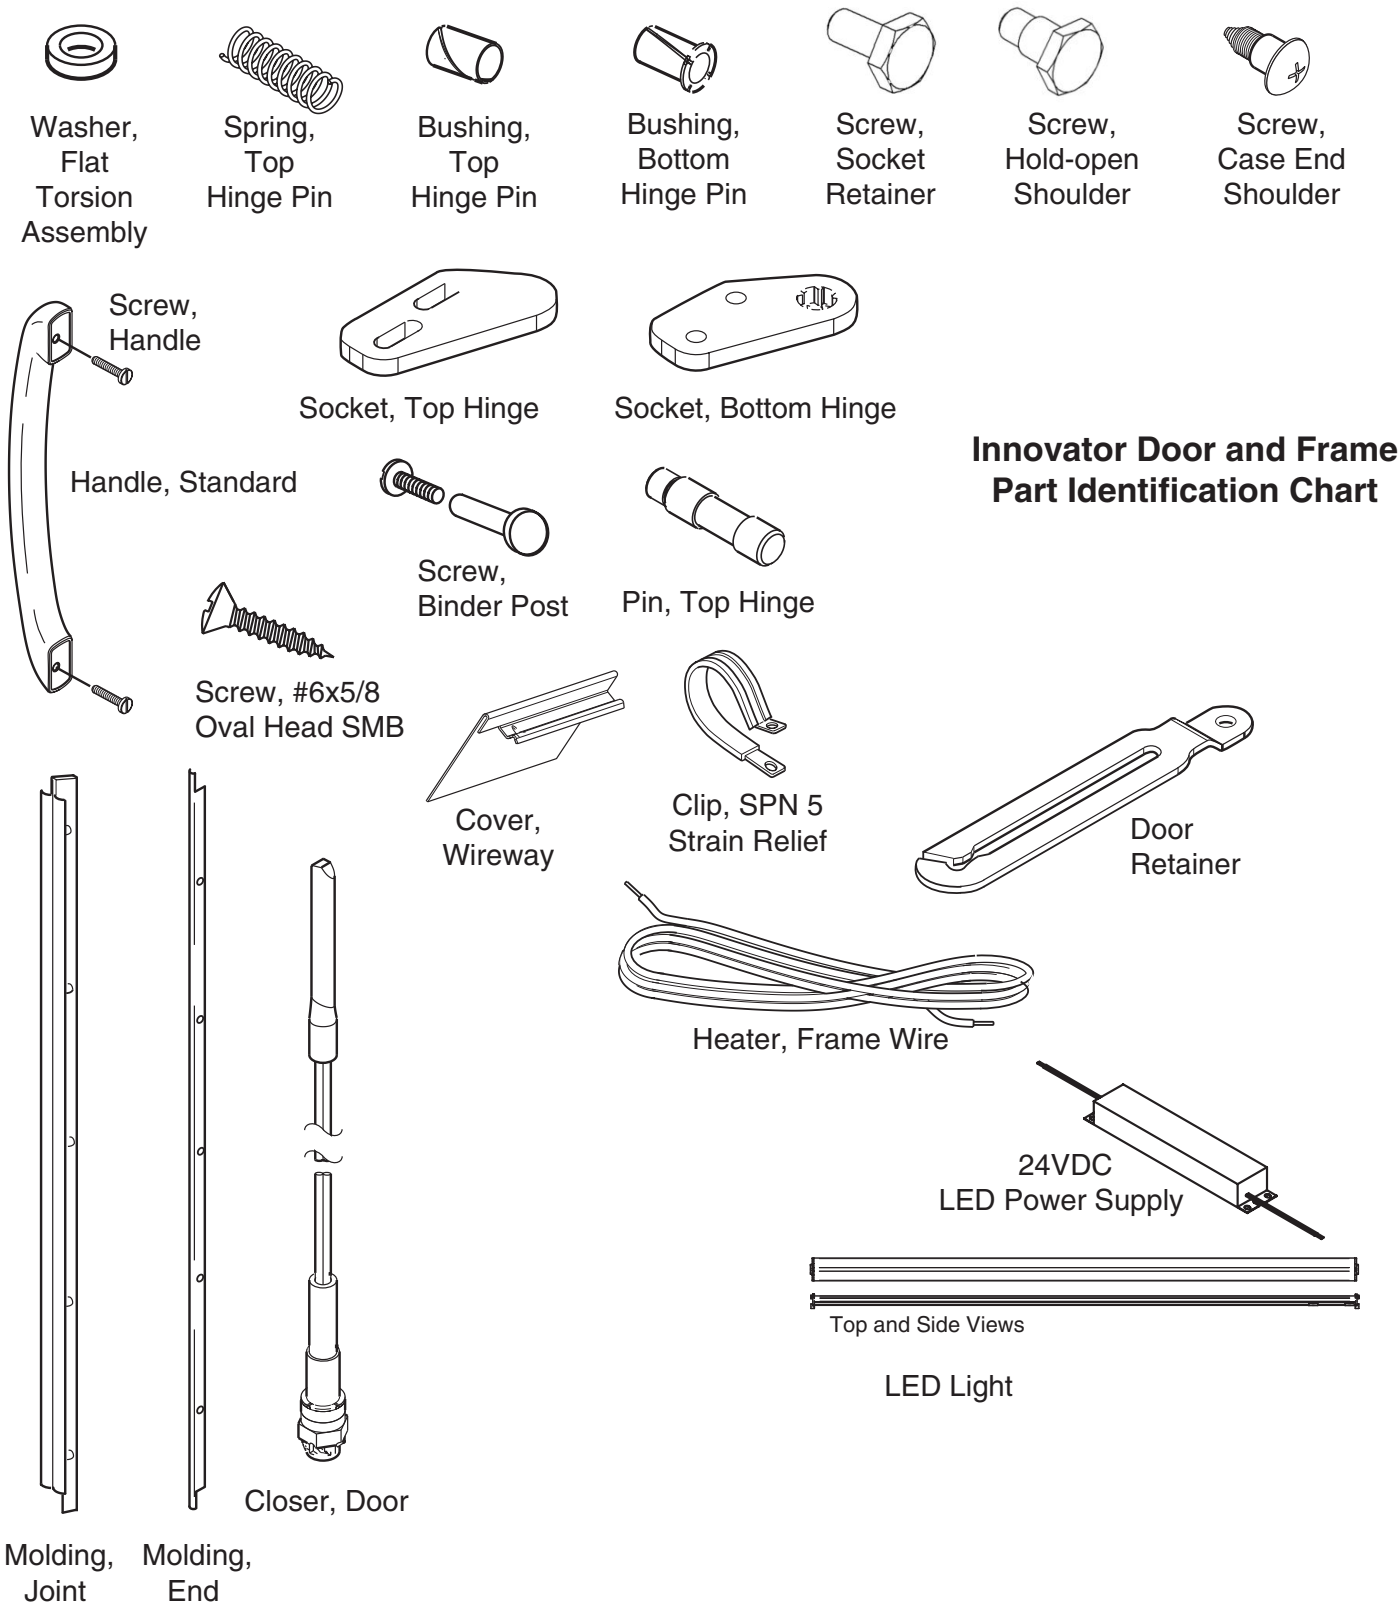

**Innovator Door and Frame
Part Identification Chart**

Innovator Door System

Replacement Parts

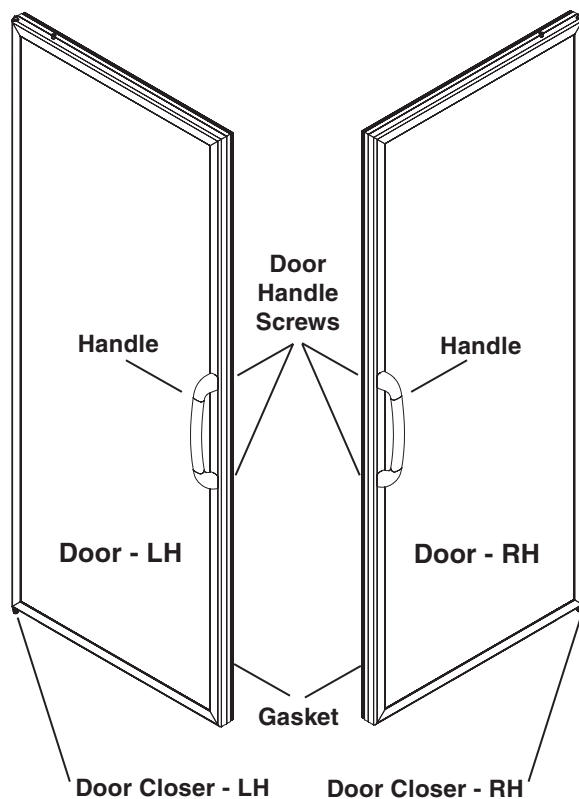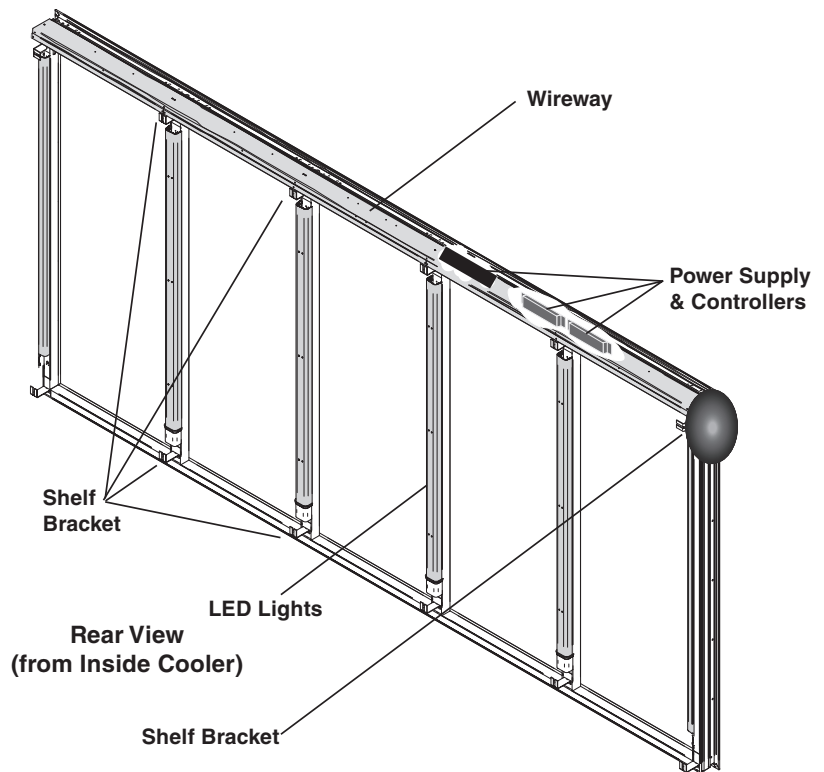

Warranty

To obtain warranty information or other support, contact your STYLELINE representative or email: warranty@styleline.com
Please include the model and serial number of the product.

For questions about your equipment, please contact our Technical Support Team at 1-866-785-8499 (Select Option 3)
Please mention that you are calling about a STYLELINE product.

For general support or service calls, contact STYLELINE at (941)-371-8110 | 800-237-3940

For replacement parts email: parts@styleline.com

Revision History

Revised to A: New design STYLELINE Innovator Door System



Scan the QR code on your mobile device to access additional product information or order parts.

Parts may also be ordered at:

parts@styleline.com

Call toll free: (941)-371-8110 | 800-237-3940

We reserve the right to change or revise specifications and product design in connection with any feature of our products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.